

STADIUM ACCREDITATION CRITERIA

FOR FA NATIONAL LEAGUE SYSTEM – MEN’S (STEPS 1-6)

& WOMEN’S FOOTBALL PYRAMID (TIERS 3-5)



2025/26 SEASON





CONTENTS

1.	GROUND	11	2.	SPECTATOR FACILITIES	36
1.1	General	11	2.1	Spectator Accommodation	36
1.2	Capacity	12	2.2	Press Seating	40
1.3	Boundary of the Ground	14	2.3	Terracing	41
1.4	Clubhouse	17	2.4	Toilets	43
1.5	Parking Facilities	19	2.5	Refreshment Facilities	47
1.6	Pitch Perimeter Barrier	21	2.5.1	Directors/Committee/Guests	47
1.7	Pitch Standards	23	2.5.2	Ground Refreshment Facilities	47
1.8	Playing Area	26	2.6	Equal Provision for All	49
1.9	Technical Area	27			
1.10	Safe Walkway	29	3.	DRESSING ROOM FACILITIES	50
1.11	Floodlighting	31	3.1	Players	50
1.12	Public Address System	32	3.2	Match Officials	52
1.13	Entrances	32			
1.14	Exits	34	4.	MEDICAL	55
1.15	Lighting	35			
1.16	TV Gantry/Camera platform	35	5.	APPLICATION FOR	56
1.17	Adjoining Pitches	35		MEMBERSHIP OF THE EFL	
1.18	Emergency Access	35			

ACRONYMS USED IN THIS DOCUMENT:

NLS: National League System

WFP: Women's Football Pyramid

RFL: Regional Feeder League(s)

FF: Football Foundation

PLSF: Premier League Stadium Fund

EFL: English Football League

SGSA: Sports Grounds Safety Authority

ATP: Artificial Turf Pitch

INTRODUCTION

Welcome to The FA's Stadium Accreditation Criteria document for the 2025/26 season. It aims to provide a complete overview of Stadium Accreditation and facility development for grounds in – or aspiring to operate at – Steps 1 to 6 of the Men's National League System and Tiers 3 to 5 of the Women's Football Pyramid.

This marks the inaugural season where the criteria document has been merged for both the NLS and WFP, and provides a one-stop-shop for clubs. As well as the criteria, there is practical guidance for new builds as well as advisory guidance to enhance the matchday and user experiences at your grounds.

Should you have any questions please direct these as follows:

For general Stadium Accreditation, assessment appointment or application of the criteria queries	stadiumpower@stadiumpower.org.uk
For queries concerning Stadium Accreditation in the men's National League System	NLS@TheFA.com
For queries concerning Stadium Accreditation in the Women's Football Pyramid	WomensPyramid@TheNLS.com

This document does not purport to contain legal or regulatory advice (including but not limited to health and safety matters and/or building regulations) and the award of a grade does not purport to confirm or certify legal or regulatory compliance which remains, in all cases, the responsibility of the club.

The FA's Stadium Accreditation Committee



1 NATIONAL STADIUM ACCREDITATION CRITERIA BY LEVEL, STEP/TIER AND LEAGUE/DIVISION

The FA Stadium Accreditation criteria is broken down as follows:

	MEN'S NATIONAL LEAGUE SYSTEM		WOMEN'S FOOTBALL PYRAMID	
Grade	Level of Football	Leagues/Divisions	Level of Football	Leagues/Divisions
Grade 1	Step 1	National League (1 Division)	-	-
Grade 2	Step 2	National League North and South (2 Divisions)	-	-
Grade 3	Step 3	Premier Divisions of the Southern, Isthmian and Northern Premier Leagues (4 Divisions)	-	-
Grade 4	Step 4	Division 1's of the Southern, Isthmian and Northern Premier Leagues (8 Divisions)	Tier 3	The FA Women's National League Northern and Southern (2 Divisions)
Grade 5	Step 5	Step 5 Leagues (16 Divisions)	Tier 4	Division 1's of The FA Women's National League (4 Divisions)
Grade 6	Step 6	Step 6 Leagues (17 Divisions)	-	-
Grade 7	Promotion to Step 6	RFL Clubs require this grade by 31 March in the season before the Club is applying for promotion to Step 6	Tier 5*	Premier Divisions of the Regional Leagues (8 Divisions)

* Whilst Tier 5 Leagues have been aligned to Grade 7, a bench-marking exercise will initially take place rather than to proceed with a strict compliance in the 2025/26 season.

Please note: Tier 6 Leagues (Regional League Division One's, 18 Divisions) are not currently aligned but the recommendation is to meet at least the NLS Regional Feeder Leagues Minimum Requirements.

2 STADIUM ACCREDITATION PROCESS: ROLES

There are many roles that varying bodies have within the Stadium Accreditation Process. Below is a matrix of the key stakeholder roles:

	Administration	Point of Contact	Criteria	Inspections	Award of Grades
The FA Executive	The FA Executive will be the conduit between the Premier League Stadium Fund and the FA Operational Committees.	Contact can be made at NLS@TheFA.com or if the query is a technical query around the design of facilities then contact the Premier League Stadium Fund by emailing: stadiumpower@stadiumpower.org.uk	The FA Executive will prepare and circulate (via Leagues) the criteria each season. This will also include any suggestions from the Premier League Stadium Fund based on data collected at assessments.		
The FA's Stadium Accreditation Committee			The Stadium Accreditation Committee is responsible for the setting of the Stadium Accreditation Criteria from season-to-season, discussing any matters arising from assessments and making decisions from time-to-time.	The Stadium Accreditation may ask the Premier League Stadium Fund to visit a given Club if feedback received suggests that there is an issue with a given ground. They also determine which Clubs are to be assessed each season.	The Stadium Accreditation Committee have sole responsibility for the awarding of grades for Clubs.
The Leagues		The League will act as a local point of contact. They have a Stadium Accreditation Lead who will be the main point of contact for Clubs, and have Stadium Accreditation Observers who will be able to attend all Stadium Accreditation assessments. Their role is to provide practical guidance in respect of ground improvements and how the criteria can be met.	The Leagues can propose any amendments to the criteria for The Stadium Accreditation Committee to consider.	A League's Stadium Accreditation Observer may attend an assessment led by a Stadium Accreditation Assessor to support the Club in achieving the grade.	
Premier League Stadium Fund (PLSF)		For more information on how the Premier League Stadium Fund can assist with ground improvements, please visit www.premierleaguestadiumfund.co.uk	The Premier League Stadium Fund can propose any amendments to the criteria for The FA's Stadium Accreditation Committee to consider.		
The Clubs	Clubs will need to respond to any administrative tasks set by The FA or the Stadium Accreditation/ Premier League Stadium Fund staff, as requested from time to time.	The points of contact we will use will either be the Club Secretary or any dedicated Club Officer as per the contacts held in Stadium Power.		Clubs will be expected to make their grounds available for assessment (within a reasonable timeframe) with a member of the Club or facility present at the assessment.	

3

OVERVIEW OF STADIUM ACCREDITATION REQUIREMENTS OF EXISTING GROUNDS

Please note: the following information is relevant to existing grounds only. New stadiums/grounds are subject to updated criteria which is referenced later in this document.

The table below is an overview of the key facilities required at each Grade. The full grading criteria is documented later in this document:

Grade	Capacity	Dugouts	Public Address System	Entrances Turnstiles	Hardstanding	Covered stand(s)		Press Seating	Existing Floodlights
	(Min.)	Min. No. of people		(Min.)	Min. Number of sides	Total min. covered accom.	Of which is seated (min.)		Lux **
1	4,000	11	Yes	8	4 ^	500	500	12	250
2	3,000	11	Yes	6	4 ^	500	250	6	180
3	-	8^^	Yes	3	4 ^	500	250	4	120
4	-	8^^	Yes	2	4 ^	300	150	2	120
5	-	8	Yes	1	3	200	100	-	120
6	-	8	No	1	2	100	50	-	120
7	-	8	No	1	2	50	-	-	N / A / 120 *

* Floodlights for promotion to Step 6 are not required until promotion is confirmed.

(i.e. installed by 30 September after promotion) but where floodlights already exist, these must meet 120 Lux.

** New floodlighting installations will be installed to a minimum of 200 Lux from Grade 2 and below.

^ Note: grounds may be declared as three-sided grounds.

^^ Please note: the Committee intends to increase the minimum dugout size from the 2028/29 to 11

3 OVERVIEW OF STADIUM ACCREDITATION REQUIREMENTS OF EXISTING GROUNDS (continued)

Grade	Spectator Ground Toilets	Spectator Ground Toilets	Players' Changing Rooms				Officials' Changing Rooms			Medical Room	
	Male	Female	Area/sqm	Showers	WC	Urinals	Area/sqm	Showers	WC	Players	Spectators
1	Four urinals & two WCs in two areas of the ground	Two WCs in two areas of the ground	18	4	1	2	6	1	1	Yes	Yes
2	Four urinals & two WCs	Two WCs	18	4	1	-	6	1	1	Yes	Yes
3	Four urinals & two WCs	Two WCs	18	4	1	-	6	1	1	Yes	Share
4	Two urinals & one WC	Two WCs	18	4	1	-	6	1	1	Yes	Share
5	Two urinals & one WC	Two WCs	12 *	4	1	-	4 **	1	1	Stretcher only	
6	Two urinals & one WC	Two WCs	12	4	1	-	4	1	1	Stretcher only	
7	Two urinals & one WC	Two WCs	12	4	1	-	4	1	1	Stretcher only	

* ideally 18sq/m

** ideally 6sq/m

Note: (i) Where urinals are specified in spectator toilets or changing rooms, these can be replaced with WCs – e.g. at Grade 5 a Club could have 3 WCs in the male spectator toilets. This is strongly encouraged for new builds to promote inclusivity of facilities.

(ii) Clubs need to consider how they meet the requirements of the Equality Act in relation to accessible clubhouse and/or ground toilets

4

DEVELOPING YOUR FACILITIES

Clubs considering any developments of their ground should focus on complying with the requirements of the current grade for the Step or Tier they play at. In planning future works, it's recommended that clubs bear in mind the Stadium Accreditation criteria for the Step they would be promoted into. It's important when planning improvements that potential future works are considered. For example, allowing space for additional seating or terracing accommodation to be added next to existing accommodation.

It is also recommended that clubs discuss proposed improvements with the **relevant League Officer and Football Foundation Technical Project Managers** (the latter if seeking funding from the PLSF) to ensure developments are appropriate to the Stadium Accreditation criteria and there is scope for future expansion if required.

Inclusive facilities

In planning for any improvement to grounds, a Club should ensure that its facilities are as inclusive as possible and that any reasonable adjustments that can be made are carried out when developing a ground. Clubs may find it useful to consult the following organisations and documents to ensure that they understand all the requirements before embarking on a project:

- Premier League Stadium Fund:
www.premierleaguestadiumfund.co.uk/
- Sports Ground Safety Authority:
www.sgsa.org.uk/
- Guide to the Safety at Sports Ground (Green Guide):
www.sgsa.org.uk/greenguide/
- Local Authority Building Control:
www.labc.co.uk/
- Level Playing Field:
www.levelplayingfield.org.uk/

Please note the above list is not exhaustive. It is recognised that Clubs will consult with local stakeholders specific to them, e.g. Supporters' Trusts etc.

Building a new ground/stadium

When building a new ground/stadium, or where significant redevelopment is taking place, the following recommendations are made:


- Establish a team within the club to progress the project.
- Appoint suitably-qualified individuals/professionals to advise you, who have experience of developing similar projects.
- Make early contact with your **relevant League Officer and Football Foundation Technical Project Manager**.
- Visit a number of clubs in or above your Step level who have recently either relocated or significantly developed their facilities.
- Ensure any design/plans drawn up are agreed by your **relevant League Officer and Football Foundation Technical Project Manager** to ensure they meet the Stadium Accreditation criteria set out in this document.

Throughout this document there are Advisory and New-Build sections which relate to new build requirements. These sections outline considerations when planning brand-new stadia.

5 UNDERSTANDING THE NATIONAL STADIUM ACCREDITATION CRITERIA

The Stadium Accreditation Criteria has traditionally been spread out over numerous documents. It has been decided these will be merged so Clubs can visualise what is required to be promoted to Step 6 and for progression through to Step 1.

To clarify, the criteria is made up of the following components:

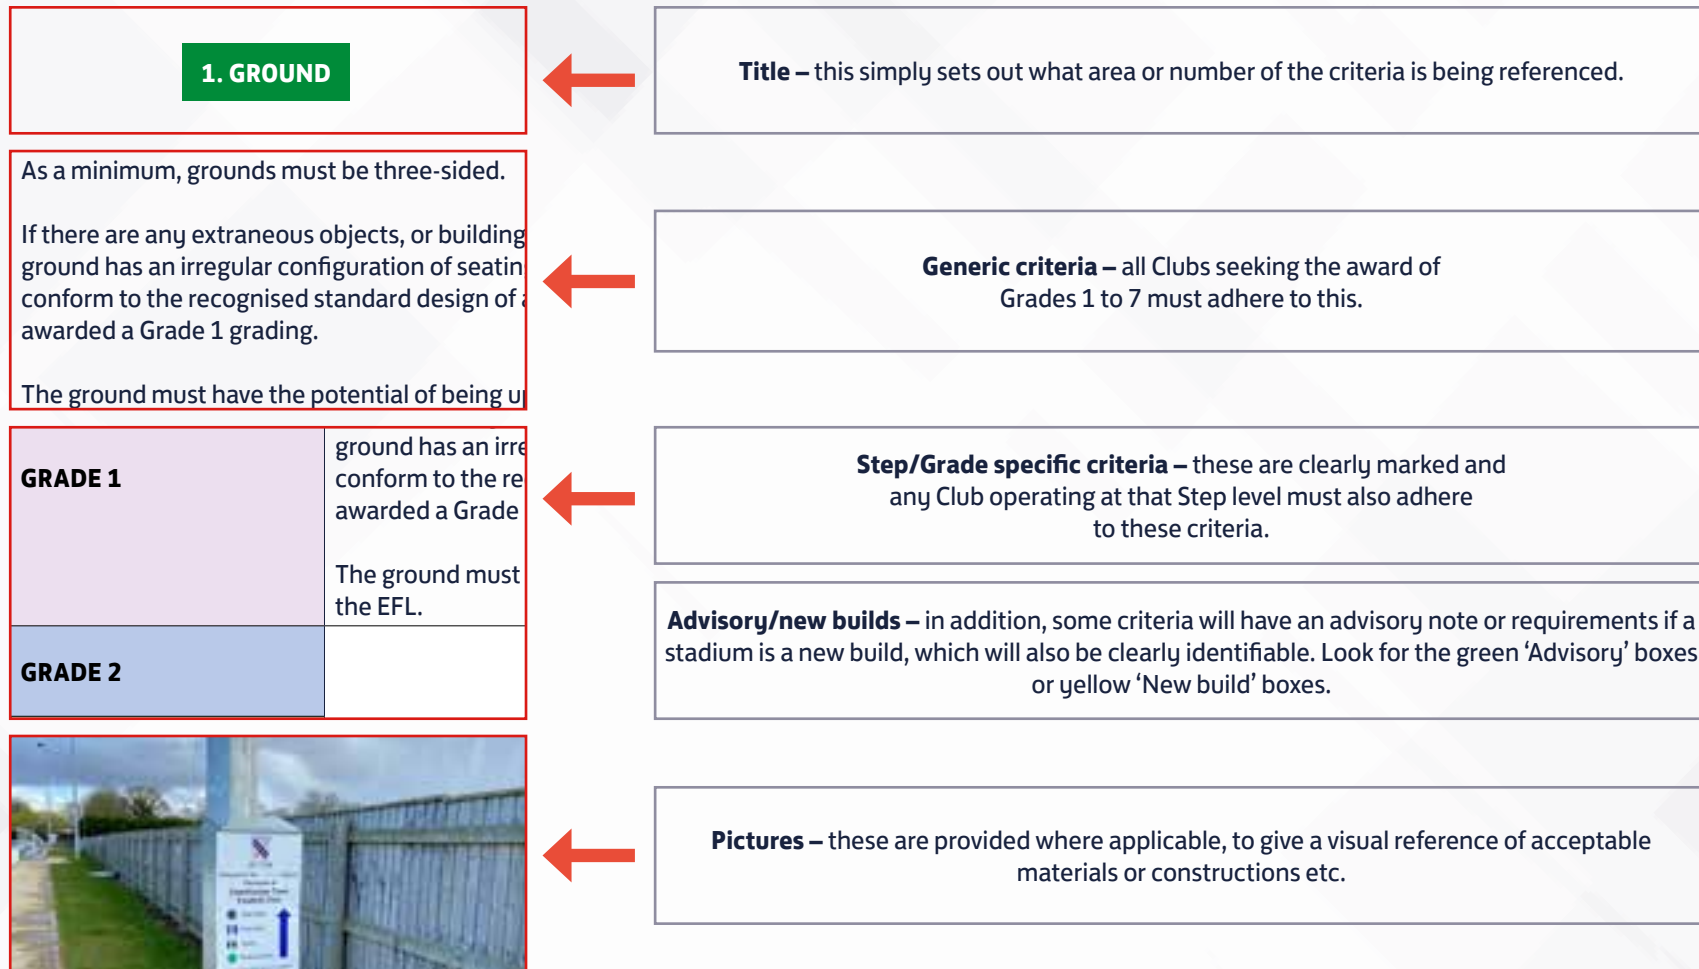



NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND

1.1 General

The ground must give an overall appearance and impression of being a football ground suitable for the level of the Men's National League System or Women's Football Pyramid at which it is operating. This includes general tidiness and being free from loose stone or objects within the ground that may reasonably be used as missiles.

In the case of those seeking entry to either the National League System or Women's Football Pyramid, the ground must be suitable for the level of the National League System or Women's Football Pyramid at which they are seeking to operate.

It must be possible for spectators to view the match, either standing or seated, for the full length of the number of sides of the playing area as listed in the chart below, provided that the capacity requirements detailed under 1.3 are met. If relevant, where any side is designated as spectator-free, measures must be in place to ensure there is no unauthorised access.

The location of the ground, in so far as its relation to the conurbation whose name the club bears, or is traditionally associated with, must meet with the approval of both the relevant FA Committee and the Board of Directors or Management Committee of the league of which it is a member.

The club must disclose plans and details of any proposed future move to a new stadium or of any significant alteration to the existing ground to both the league of which it is a member and to The FA.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	As a minimum, grounds must be three-sided. If there are any extraneous objects, or buildings within the boundary of the ground or the ground has an irregular configuration of seating, standing and covered areas that do not conform to the recognised standard design of a football stadium, the club may not be awarded a Grade 1 grading. The ground must have the potential of being upgraded to meet the criteria for membership of the EFL.
GRADE 2	As a minimum, grounds must be three-sided.
GRADE 3	
GRADE 4	
GRADE 5	
GRADE 6	As a minimum, grounds must be two-sided.
GRADE 7	As a minimum, grounds must be two-sided.
NEW BUILDS AND CONVERSIONS	Consideration must be given to the location of any new ground, its accessibility and sustainability with regards to users, spectators and neighbours.

6 NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.2 Capacity

At Grades 1 and 2, the stadium must have a minimum capacity of spectators in line with the chart below, inclusive of any seated spectators. This must be demonstrable and certified by the local authority or calculated by an approved Competent Person, in accordance with the current edition of the 'Guide to Safety at Sports Grounds' (commonly known as and referred to in this document as the 'Green Guide') at the time of inspection. Where a Club is confirmed as promoted to Step 2, they must submit an initial capacity calculation (carried out in accordance with the procedure above) to The National League by 31st May in the season the Club is promoted.

When calculating the capacity of a ground, Clubs are reminded that this will be in accordance with the Green Guide. The Green Guide requires a minimum of 0.9m hardstanding clear walkway around the sides of the pitch which should not be occupied by spectators and cannot be included in the capacity calculation. Flat, bound surfaces can only have a maximum depth of four rows of people (subject to there being room to have four-deep) e.g: length of flat standing area (m) x 1.5m (maximum flat viewing depth) x 4.7 (density per sq/m). Flat, well maintained grassed areas (where permitted to be within an enclosed ground) will not count towards the capacity calculation.

The FA and/or the relevant League reserve the right to appoint a suitably-qualified person to review and, if found necessary, amend the capacity figure. Such intervention may be at the cost of the Club.

It is in the best interest of each Club to hold an official capacity figure, even if not required by the criteria below, as this will help Clubs to maximise attendances for fixtures that could attract large crowds.

6 NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	<p>A capacity of 4,000 is required, with the (demonstrable) potential to increase this to 5,000 in the future.</p> <p>The club must have the ability to segregate home and visiting supporters. Any segregated area must have exclusive entrances, exits, accessible, female and male toilet facilities and catering facilities. The latter may be of the mobile type.</p> <p>All Step 1 fixtures are subject to the Football Spectators Act 1989 (which amongst other things contains provisions relating to football banning orders) and the Football (Offences) Act 1991 (which amongst other things creates offences that are specific to football matches).</p>
GRADE 2	A capacity of 3,000 is required, with the (demonstrable) potential to increase this to 4,000 in the future.
GRADE 3	Whilst no formal calculation is required, Clubs should aim for a minimum capacity of 1,950. As is listed above, if a Club is promoted to Step 2 it will need to demonstrate that a minimum capacity of 1,950 is currently met and show plans as to how a capacity of 3,000 will be met by the following 31 March.
GRADE 4	Whilst no formal capacity calculation is required, Clubs should aim for a capacity of 1,300.
GRADE 5	There is no minimum capacity at this level, but a club should be mindful that the minimum requirement for Grade 2 is 3,000 and that 1,950 and 1,300 are suggested for Grades 3 and 4, respectively.
GRADE 6	
GRADE 7	
NEW BUILDS AND CONVERSIONS	Consideration must be given to the desired capacity which the club is aiming for and the facilities it wants to provide. It is important that clubs have the space within their stadiums to allow where possible for cost-effective expansion of stands and terraces to take place in order to meet the capacities outlined above.

6

NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.3 Boundary of the Ground

All grounds at Grades 1 to 6 must be enclosed by a permanent boundary. However, to be promoted from Regional Feeder League level, such boundaries do not have to be permanent.

At Steps 1 to 5, there must be no Public Right of Way (see 'advisory' for definition) through an enclosed ground.

At Step 6, where a Public Right of Way (see 'advisory' for definition) through an enclosed ground is present, the Club must present documentation that adequately demonstrates that such Right of Way is not permitted on matchdays. Such documentation will then be considered by the Stadium Accreditation Committee and will be subject to review at the notice of the Committee.

	Prevent viewing from outside ground?	Type/permitted materials	Height	Other comments
GRADE 1	Must prevent the ability for individuals from viewing the game comfortably from outside the ground (i.e. not have an unimpeded, significant view of the field of play, see both goal posts etc...).	Of sound construction, such as pre- cast concrete, brick, breeze block or metal cladding with steel or concrete posts.	Minimum of 1.70 metres as measured from outside the ground.	Where any side of the ground is bounded by private land/property, the fixed boundary of that private land / property may be acceptable as the boundary of the ground, provided this is approved by The FA.
GRADE 2		Lapped timber, latch panel wood fences and wire mesh fences with wooden posts may be acceptable. Hedges, shrubs and/or trees will not normally be accepted.		Where a side or an end of the ground is designated spectator free because of an adjoining sports field or amenity there must be a fence along the entire length or width of the ground to separate the two facilities. The fence, which may be demountable, must be a minimum height of 1.70 metres and it must not be possible to view the match from outside.
GRADE 3				
GRADE 4		At Grade 1 only , it must be secure on all sides of the ground and sufficient to deter would be climbers.		
GRADE 5	It is not a requirement to prevent external viewing at this level.	No materials specified. It is recommended, where possible, to future-proof the ground by constructing using the above materials.	As a general rule, the minimum height, when measured from outside the ground, must be 1.70 metres.	Where any side of the ground is bounded by private land/property, the fixed boundary of that private land / property may be acceptable as the boundary of the ground, provided this is approved by The FA.
GRADE 6				
GRADE 7				Boundary does not have to be of a permanent nature.

6

NATIONAL STADIUM ACCREDITATION CRITERIA


1. GROUND (continued)

	Prevent viewing from outside ground?	Type/permitted materials	Height	Other comments
NEW BUILD AND CONVERSIONS	Consideration must be given to the suitability of the boundary of the ground and the materials used to screen and secure the ground should be suitable for the location of the ground.			
ADVISORY	<p>“Public Right of Way”:-</p> <p>A public right of way is a legally defined path or route that anyone can use, generally for walking, sometimes for other activities like horse riding or cycling, and sometimes even vehicular traffic. These rights of way are established through legal processes and are considered public highways, meaning they are subject to legal protection like all other public roads.</p> <p>Legal Right Public rights of way are not just paths; they represent a legal right for the public to use a specific route.</p> <p>Types of Rights of Way The term “public right of way” encompasses various types, including footpaths (for walkers), bridleways (for walkers, horse riders, and cyclists), restricted byways (allowing walking, horse riding, cycling, and horse-drawn vehicles), and byways open to all traffic (BOATs) which can be used by all types of traffic.</p> <p>Land Ownership It’s important to note that public rights of way can exist on land that is privately owned. The public has a legal right to use these routes despite the landowner’s ownership.</p> <p>Public Right of Way Officer Clubs are advised to speak to their local Public Right of Way Officer should any clarity be sought.</p>			

6 NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

EXAMPLES OF GROUND BOUNDARIES

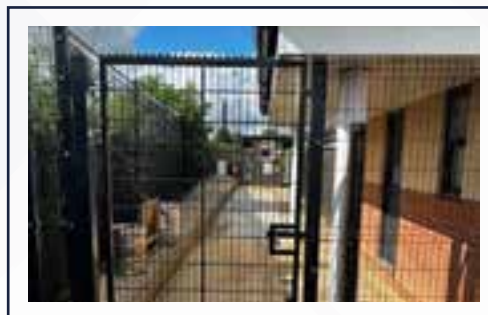



NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.4 Clubhouse

There must be a clubhouse facility either on or adjacent to the ground, which must be open on matchdays to provide refreshments refreshments (unless refreshments are provided elsewhere in the ground) and toilet facilities for spectators. Where a ground has concourses with the same provision as above, these can replace the need for a clubhouse.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	The Clubhouse must also provide refreshments to visiting Players, Officials and Match Officials, unless provided for elsewhere in the ground.
GRADE 2	
GRADE 3	
GRADE 4	
NEW BUILDS AND CONVERSIONS	Clubhouse facilities should be welcoming to all spectators and users. High-quality facilities may increase revenues for clubs through the sale of food and refreshments. Consideration needs to be given to the number of male, female and accessible toilets as well as making provision for baby-changing facilities.
ADVISORY	<p>It is strongly recommended that clubhouses have a dedicated provision for accessible toilets.</p> <p>Please note: the Committee intends to carry out an audit of accessible facilities in NLS/WFP football stadia. In the interim, when making improvements to a grounds toilet facilities, Clubs are strongly recommended to seek professional guidance as to how they can make their facilities more accessible.</p>

6

NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

EXAMPLES OF CLUBHOUSES



6

NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.5 Parking Facilities

At Grades 1 and 2: There must be adequate car parking facilities at or adjacent to the ground. Car parking within the boundary of the ground on matchdays may not be acceptable if the control or admission of spectators is not deemed suitable or the safety of spectators is compromised.

At Grades 3 to 7: There should be adequate car parking facilities on or adjacent to the ground. Car parking within the boundary of the ground on match days may not be acceptable if the control or admission of spectators is not deemed suitable or the safety of spectators is compromised.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	<p>Parking facilities must be provided for directors, with a minimum number of four places for visiting directors.</p> <p>There must be safe parking arrangements for the visiting team’s coach.</p> <p>Unmarked parking facilities must also be provided for the match officials.</p>
NEW BUILDS AND CONVERSIONS	<p>Parking should be in line with any guidance produced by the Local Authority from whom the club is seeking planning permission.</p>

6

NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

EXAMPLES OF PARKING FACILITIES



6 NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.6 Pitch Perimeter Barrier

Subject to the provisions detailed below, there must be a permanent fixed barrier ideally 1.1 metres high (save for where a lowered barrier is required for sightline purposes) as measured from the spectator side, of sound construction (e.g. concrete and steel) and free from all sharp edges, surrounding the pitch on all sides that may be occupied by spectators. Existing barriers/ rails of less than 1.1 metres in height may be acceptable, provided they meet the requirements set out in the advisory section below. There must be a minimal gap between the edge of the hardstanding and the vertical point from the bar at the top of the pitch perimeter barrier. In all cases this must not exceed 30 centimetres.

Immediately in front of seated accommodation, the boundary of the playing area may be indicated by means other than a permanent fixed barrier, provided that the Club is able to provide assurances that no spectator will be allowed to stand in this area to watch the match.

Where there is a walkway in front of a standing terrace that itself is fronted by a crush barrier that has been subject to an annual risk assessment and, if necessary, tested, an alternative to a fixed barrier (e.g. infilled A-frames) may be used, provided no spectators are allowed to stand in this area to watch the match. The Club must implement a safety management system to ensure this, which also protects the integrity of the playing area.

Where A-frames are utilised instead of a fixed barrier, they must be continuous and infilled.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	The barrier, if other than solid wall type of construction, must be infilled so that the ball cannot pass through or under it. Plastic multi-purpose hi-vis fencing is not considered suitable for infill. * There must be no less than 2.25 metres (and ideally there should be 2.75 metres) between the touchline, goal line and the pitch perimeter barrier.
GRADE 2	The barrier, if other than solid wall type of construction, must be infilled so that the ball cannot pass through or under it. Plastic multi-purpose hi-vis fencing is not considered suitable for infill.
GRADE 3	
GRADE 4	
ADVISORY	It is important to distinguish between a pitch perimeter barrier/rail which exists to separate spectators from the playing area and a crush barrier which has been constructed and tested in accordance with the requirements of the Green Guide. Where the structure cannot be designated as a crush barrier, e.g. its height exceeds 1.1 metres, the maximum depth of standing behind it is limited to 1.5 metres. This must be borne in mind in any capacity calculations. It is recognised that the above may not be an issue for normal attendances but, when a larger crowd is anticipated, the Club should be mindful of the associated management issues and, if necessary, take professional advice. Whatever system is employed, a club should be mindful of its responsibility to ensure spectator safety and minimise the possibility of unauthorised incursions on the playing area.
NEW BUILDS AND CONVERSIONS	Any barriers installed at new grounds should be purpose-designed, with integrated infill panels as required. They should be made from UPVC or coated metal. Fixing of panels and sponsors' signs should be done in a safe way to avoid injury to players sliding into the barrier. Clubs should carry out their own regular risk assessments. Where obstacles such as buildings or floodlight columns are in place in lieu of a barrier, a risk assessment must be carried out. Where identified, measures to protect players should be put in place. In the case of a new stadium, the minimum run-off between the pitch and the pitch perimeter barrier should ideally be four metres and must be a minimum of three metres. The run-off must be free of any fixed object such as goals (that are not part of the field of play), dugouts and floodlight columns. Note: replacing a grass pitch with an Artificial Turf Pitch does not constitute a 'New build' and therefore is not bound by the three-metre run-off above.

6

NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

EXAMPLES OF PITCH PERIMETER BARRIERS



6 NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.7 Pitch Standards

The playing surface must be grass, unless otherwise authorised by the Competition's Board of Directors, and must be of the highest possible standard. It must be level and free from surface depressions and excessive undulations and must be maintained to the highest possible standard at all times. If the Competition is concerned with the standard of the playing surface they may, at the Competition's discretion, take any reasonable action against the Club.

Clubs are advised to use the Football Foundation's PitchPower digital tool (www.footballfoundation.org.uk/pitchpower). PitchPower is operated by the Football Foundation and records and measures grass pitch quality. It also provides advice and guidance directly to Groundskeepers and clubs on how to improve the quality of the playing surface, through expert advice provided by the Grounds Management Association. By using PitchPower during set windows of the season, clubs will be able to record the quality of their playing surface and if needed, adapt their maintenance procedures to ensure that the playing surface is of the highest quality.

The Competition's Board of Directors or Management Committee may require a club at any time to undertake a PitchPower performance test if it felt that a pitch is not of the highest-possible standard (e.g. if the fulfilment of fixtures appears to be impacted by grass pitch quality) or to assess suitability of hosting a ground share.

The maximum slope allowable shall not exceed an even gradient of vertical to horizontal 1:41 in any direction. When a new pitch is being developed or significant improvements are being made to a pitch, a gradient of 1:41 will not be acceptable and the pitch must be constructed with reference to the FA Grass Pitch Performance Quality Standard.

Run-Offs

There must be a minimum of 1.83 metres (*for Grade 1 – see the table below) between the touchline, goal line and the pitch perimeter barrier. This run-off must be of the same material as the playing surface – i.e. grass or artificial turf – save for where artificial turf has been professionally laid without trip hazards, as part of the run-off for example: as per an assistant referees running area. Where an assistant referee's running area is artificial turf on a grass pitch, this must be continuous – i.e. not changing from one surface to another along the running area. Athletics stadia may be permitted to use running track material in the very corners where the track bends (and in some circumstances to the length and width of a pitch), provided The FA have given approval.

Spare goal storage

Where a ground has spare portable goals these must be stored in a dedicated goal storage area and not left on the pitch run-off. Any such storage must not affect spectator viewing or interfere with the players' eye line.

Artificial Grass Pitches (AGP)

Artificial (3G) football turf may only be used provided conditions (i) to (vii) below have been met (the "Performance Standard"):

Grades 1 to 2: The pitch must be surfaced with 3G football turf that has laboratory type approval according to the FIFA Quality Concept for Football Turf (2012 & 2015 editions) – FIFA Quality Pro Performance (notwithstanding 1.8(v) below).

Grades 3 and below: The pitch must be surfaced with 3G football turf that has laboratory type approval according to the FIFA Quality Concept for Football Turf (2012 & 2015 editions) – **FIFA Quality Performance**.

- (i) The 3G football turf pitch must be listed on both The Football Association's register of 3G football turf pitches and FIFA's 3G football turf pitches register by no later than 31 May and tested **annually** at the Club's expense.
- (ii) Where a 3G football turf pitch is not yet listed on The Football Association's register (for example if it is a newly-installed pitch), a Club must obtain a Laboratory Performance Test Report and submit it to The Football Association by no later than 31 July at the Club's expense.
- (iii) The Football Association reserves the right to instruct a Club to have its pitch tested at any time to ensure that it meets the relevant Performance Standard. All such tests shall be at the Club's expense.



NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

(iv) The 3G football turf, including run-offs, shall be one continuous playing surface and shall be green in colour at least one metre from the outer edge of the touchline and goal line. All line markings shall be in accordance with the Laws of Association Football.

(v) Only Clubs with FIFA Quality Pro Standard Certificated 3G Football Turf Pitches will be eligible to take part in matches under the auspices of The National League (i.e. NLS Steps 1 and 2), save that:

a. Club which has a ground with the recommended FIFA Quality Performance Standard installed on or before 31 July 2016 can be promoted to Step 2 of the National League System, providing that it undertakes, upon renewal of the pitch, to install a pitch that meets the FIFA Quality Pro Standard; or

b. A Club can be promoted to Step 2 provided that:

- i. By 31 May in the season prior to promotion, the Club undertakes that its pitch will be awarded a FIFA Quality Pro certificate by no later than the following 31 May (i.e. 31 May in the Club's first season participating at Step 2).
- ii. By 31 March in the Club's first season participating at Step 2, the Club provides an update to the Board detailing the progress made with reference to the undertaking, an updated funding position and such other information as the League's Board considers necessary.

The Club's undertaking must include at least the following information:

- Details about how any necessary works will be completed (including any relevant planning permissions required and a plan for those to be obtained).
- Details of the costs involved in completing the works and evidence to demonstrate how those costs will be funded.

(vi) A Club with a 3G Football Turf Pitch installed on or after 1 August 2016, with the intention of being promoted to NLS Step 2 must test the pitch by 31 March to the FIFA Quality Pro Standard to ensure it meets the standard required. Any remedial work to meet the FIFA Quality Pro Standard must be completed by 31 May, be re-tested at the Club's expense and awarded the FIFA Quality Pro Standard certification. Failure to do so will result in relegation to the appropriate Step.

(vii) The pitch must be a consistent green colour (i.e. no stripes/patterns) including at least the first one metre of run-off

New Rules have been introduced in the summer of 2025 to regulate the timeframes permitted when converting artificial turf pitches:

No installation works shall commence until such time as the Competition has given written approval for the proposed installation and the timetable thereof. The Competition will not grant approval unless the Club is able to evidence that:

- Installation works are scheduled to take place before 15 July in any year with a confirmed end date.
- Any necessary funding for the installation works is in place.
- A fully executed groundshare agreement (in a form acceptable to the Competition) is in place for the period of the installation.
- Where required pursuant to a lease, permission for the installation works has been obtained.

If approval is granted but installation works do not commence by 15 July in the relevant year, the Competition may withdraw its approval and order that the works cannot commence until the end of the Playing Season.

6

NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

<p>NEW BUILDS AND CONVERSIONS</p>	<p>New Build 3G FTP or Conversion of grass to 3G FTP</p> <p>It is recommended that clubs considering the above projects do the following:</p> <ul style="list-style-type: none"> • Make contact with your relevant League Officer and, where seeking funding from the Premier League Stadium Fund, Football Foundation Technical Project Manager before embarking on any type of feasibility study. • Ensure that any design/plans that are drawn up are agreed by your relevant League Officer and, where seeking funding from the Premier League Stadium Fund, Football Foundation Technical Project Manager to ensure your proposals will meet the relevant FIFA Performance Standard and Stadium Accreditation Criteria. • The onus is on the club to ensure that they seek expert help and advice to meet the stadium accreditation criteria. • The playing area of a new 3G pitch must be a minimum of 100 metres x 64 metres and must conform to the requirements of the Laws of the Game. The run-off around the pitch should be a minimum of three or four metres between the touchline, goal line and the pitch perimeter barrier. • Where clubs are installing a 3G in lieu of a grass pitch they must ensure that the pitch is a minimum of 100 metres x 64 metres and must conform to the requirements of the Laws of the Game. • Make contact with your relevant County FA Facility Lead. <p>Where a three or four-metre run-off cannot be met because of existing stadia, the following must be achieved:</p> <ul style="list-style-type: none"> • Grade 1: Ideally there should be 2.75 metres, but no less than 2.25 metres between the touchline, goal line and the pitch perimeter barrier. • Grades 2 to 6: There must be a minimum of 1.83 metres between the touchline, goal line and the pitch perimeter barrier. <p>Clubs whose grounds might be hosting FIFA or UEFA competition matches must consult specific guidance as the standard size recommendations are greater than the requirements above.</p>
--	---

6

NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.8 Playing Area

The playing area must be a minimum of 100 metres x 64 metres and must conform to the requirements of the Laws of the Game.

Goalposts and goal net supports must be of professional manufacture and conform to the relevant safety requirements and the requirements of the Laws of the Game.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	The Club must be responsible for the upkeep of the playing area. If a club employs an external third party to maintain the playing surface, the details of that third party must be disclosed to The FA and the National League Board of Directors.
ADVISORY	Clubs should ensure that their goalposts meet the standards set out in criteria provided by The FA. it should be noted that the use of metal cup hooks is prohibited. Clubs should refer to 'The FA Guide to Pitch Design, Management and Goalpost Safety'.
NEW BUILDS AND CONVERSIONS	<p>New pitches must be a minimum of 100 metres x 64 metres and must conform to the requirements of the Laws of the Game. The run-off around the pitch should ideally be four metres or a minimum of three metres.</p> <p>Clubs whose grounds might be hosting FIFA or UEFA competition matches must consult specific guidance as the standard size recommendations are greater than the requirements above.</p>



NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.9 Technical Area & Dugouts

Two covered dugouts, clearly marked 'Home' and another with 'Away' or 'Visitors', must be provided unless adequate provision is made in a seated stand. They must be on the same side of the pitch, ideally either side of the halfway line, ideally both equidistant from it and ideally a minimum of three metres apart. They should provide an unobstructed view of the playing area.

Portable dugouts are permitted but must be securely fixed while in use.

A technical area must be marked out, in accordance with the criteria contained in the '[Laws of the Game](#)' booklet and be of equal size:

The only exception to the width of the technical areas exceeding 1m either or both sides of the dugouts is in cases where markings are stitched into Artificial Turf Pitches and have been 'future-proofed' for larger dugouts at the higher Grade.

GRADE 1	Each of the seating areas must be able to accommodate a minimum of 11 adults on fixed seats or benches . Where bench seating is provided, a minimum of 0.5 metres must be allowed for each person. (i.e. 11 persons require a minimum of 5.5 metres)
GRADE 2	
GRADE 3	Each Dugout must be able to accommodate a minimum of 8 persons* under cover on fixed seats or benches. Where bench seating is provided, a minimum 0.5 metres must be allowed for each person (i.e. 8 persons require a minimum of 4 metres.). It should be noted that for Grade 2 there must be seating for 11 persons (as detailed further above) – it is recommended that any Club promoted to Step 2 meets the Grade 2 requirement before commencing the season.
GRADE 4	
GRADE 5	Each Dugout must be able to accommodate a minimum of 8 persons under cover on fixed seats or benches. Where bench seating is provided, a minimum of 0.5 metres must be allowed for each person (i.e. 8 persons require a minimum of four metres.).
GRADE 6	
GRADE 7	
NEW BUILDS AND CONVERSIONS	When new Dugouts are being constructed or installed, they must be on each side of the halfway line, equidistant from it and a minimum of three metres apart. The seating part of the dugout or any physical structure should not encroach into the run-off.


* Please note: the Committee intends to increase the minimum dugout size from the 2028/29 to 11

6

NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

EXAMPLES OF TECHNICAL AREAS

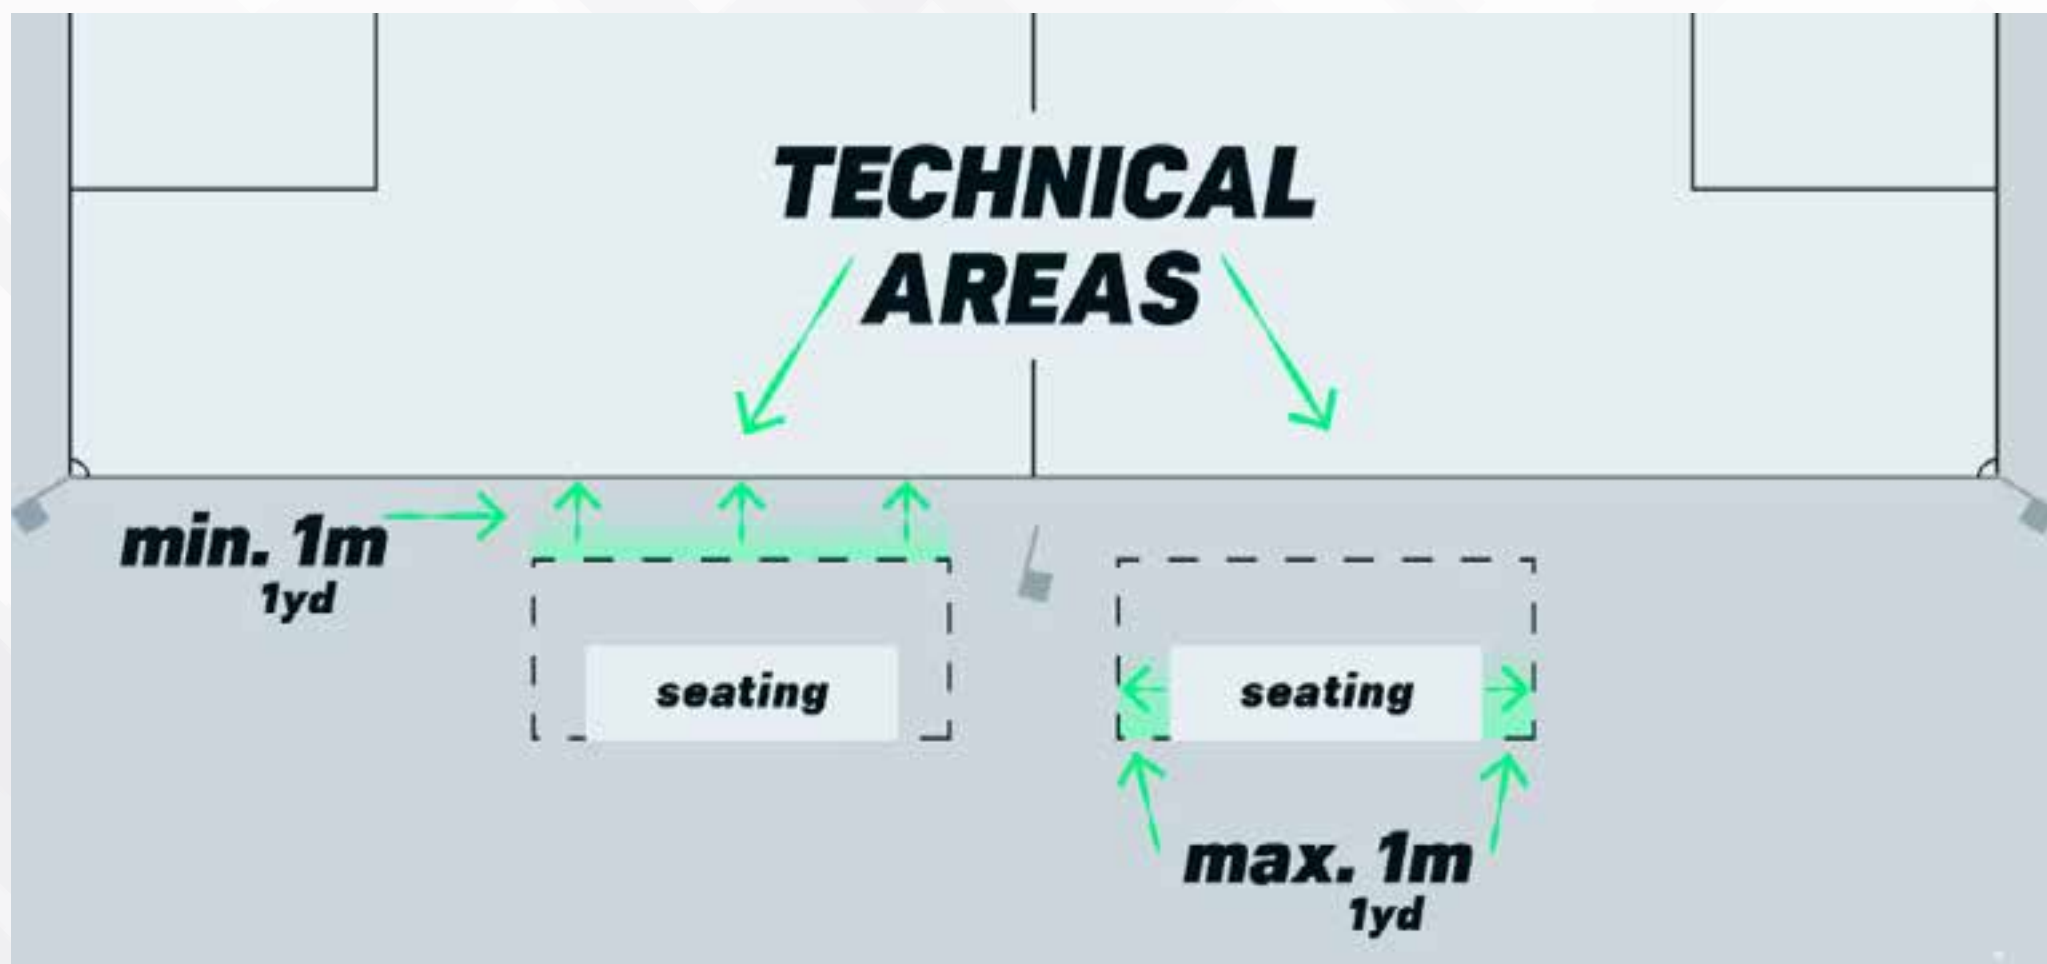

6

NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.10 Secure Walkway

There must be a safe, unimpeded passage for players and match officials between the dressing rooms and the pitch.

The design of the secure walkway will inevitably differ from ground to ground and it will rarely guarantee the safe passage of players and match officials unless supplemented by stewards. A Club should implement procedures appropriate to the particular structure and be ready to respond to on-field situations which might affect spectator behaviour.

GRADE-SPECIFIC REQUIREMENTS	
GRADE 1	The use of protection designed products such as permanent structures or retractable tunnels to separate players and spectators is recommended, and should be secured in place when in use.
GRADE 2	
GRADE 3	
GRADE 4	
GRADE 5	
GRADE 6	There must be a safe, unimpeded passage for players and match officials between their dressing rooms and the pitch. The design of the safe walkway may differ according to the circumstances of each different ground. It is recommended that stewards are used to assist the safe passage of players and match officials. A club should implement procedures appropriate to the particular structure and be ready to respond to on-field situations which might affect spectator behaviour.
GRADE 7	
NEW BUILDS AND CONVERSIONS	Consideration should be given to the entrance and exit of the field of play and the distance involved to ensure the safety of players and officials and minimum contact if afforded to spectators.

6 NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

EXAMPLES OF SAFE WALKWAY





NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.11 Floodlighting

Floodlights must be provided to an average lux in accordance with the requirements in the table below.

Readings shall be on a grid of 88 markings (8 across, 11 down) evenly spaced with the outside readings taken 2.5 metres inside from the touchline. The average of all the readings is taken to be the average illumination level in lux of the floodlighting installation.

The lux values must be tested every two years in accordance with current guidelines by an approved independent contractor. Floodlights must be retested after any significant alterations. Existing certification will be accepted provided that the test was carried out within the last two years unless work has been carried out at the ground which may have affected previous readings.

It is also recommended that, at the same time as testing the lights, clubs also test the electrical supply within the ground to ensure that the system complies with current electrical standards and also request a visual inspection of the columns for signs of corrosion, fatigue and overloading.

An example of an 'approved' contractor is one who possesses the NICEIC (National Inspection Council for Electrical Installation Contracting) Approved Contractors Award or ISO 9000/BS 5750 (International Standards/British Standards), or who is a member of the Electrical Contractors' Association. Alternatively, it can be a contractor deemed acceptable by the league.

The contractor must, when detailing the lux values, give confirmation in writing of the date when the illumination test equipment used was last calibrated.

Floodlights must not have operational restrictions that impact on the ability to host and complete Saturday matches with a 3pm kick-off and/or at least one midweek evening per week with a 7:45pm kick-off. This includes the possibility of extra time and kicks from the penalty mark in some competitions.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	Floodlights must be provided to an average lux reading of at least 250. No single reading can be less than 100 lux and no single reading can be less than one quarter of the highest reading, to ensure an even spread of light. When applying for a higher grading, the certificate should have been issued no more than six months prior to application.
GRADE 2	Floodlights must be provided to an average lux reading of at least 180. No single reading can be less than 100 lux and no single reading can be less than one quarter of the highest reading, to ensure an even spread of light. When new or improved installations are being planned, the lighting procured must meet BS 12193 Class 2 and have an average lux reading of at least 200 with the capability of increasing to 250 if promoted to Step 1. When applying for a higher grading, the certificate should have been issued no more than six months prior to application.
GRADE 3	Floodlights must be provided to an average lux reading of at least 120. No single reading can be less than one quarter of the highest reading, to ensure an even spread of light. When new or improved installations are being planned, the lighting procured must meet BS 12193 Class 2 and have an average lux reading of at least 200.
GRADE 4	
GRADE 5	
GRADE 6	
GRADE 7	
NEW BUILDS AND CONVERSIONS	Before installing new floodlights or upgrading existing floodlights, clubs are advised to consult with their Local Authority planning department. All new installations and upgrades must be LED floodlights.

6 NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.12 Public Address System

At Grades 1 to 5, a public address system must be provided which is clearly audible in all areas of the ground which can be occupied by spectators.

1.13 Entrances

The table below denotes the number of operational spectator entrances that are required for each Grade to control the ingress of spectators.

Electronic turnstiles with bar code readers are also acceptable but an emergency procedure must be in place in the event of a power failure and be detailed within a Club's Emergency Action Plan.

Adequate protection and security must be incorporated for the turnstile operator or, where tickets are sold from a box office, the cashier. This must include a grille (or similar) and a lock on the inside of the turnstile (or paybox at Step 5 and below).

It must be possible to gain access to the spectator viewing areas from the turnstiles via a bound surface minimum width of 0.9 metre (ideally 1.2m).

All entrances should be placed in appropriate positions around the boundary of the ground and take into account the requirements of segregation of spectators of both teams.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	8 spectator entrances that must be controlled by fully operational turnstiles of the revolving type and must be suitably housed and lit.
GRADE 2	6 spectator entrances that must be controlled by fully operational turnstiles of the revolving type and must be suitably housed and lit.
GRADE 3	3 spectator entrances that must be controlled by fully operational turnstiles of the revolving type and must be suitably housed and lit.
GRADE 4	2 spectator entrances that must be controlled by fully operational turnstiles of the revolving type and must be suitably housed and lit.
GRADE 5	1 spectator entrance is required for these Grades. This should be controlled by a fully operational turnstile of the revolving type, however, a pay box (which is not accepted at Grades 1 to 4) where a charge for entry can be taken is acceptable (please note: a table will not be deemed acceptable as a pay box as it offers the cashier no protection).
GRADE 6	
GRADE 7	
ADVISORY	Part of a ground capacity calculation is calculated using entrances and exits, clubs should refer to the criteria set out in the Sports Ground Safety Authority – Guide to Safety at Sports Grounds .
NEW BUILDS AND CONVERSIONS	Consideration should be given to the location of entrances, the ground capacity and the ability to offer segregation to home and away spectators. It must be possible to gain access to the spectator viewing areas from the turnstiles via a bound surface minimum width of 1.2 metres.

6

1. GROUND (continued)

EXAMPLES OF ENTRANCES



6 NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.14 Exits

All spectator exits must be clearly signed with appropriate ‘running man’ signs, and for Grades 1 & 2 be numbered or lettered (e.g. “Exit 1”, “Exit A”), and are to be kept clear and free from obstructions. For further information, reference should be made to the [Green Guide](#).

A bound surface must be provided connecting to any exits from the nearest spectator viewing areas (i.e. pitch perimeter hardstanding).

Where there is a gate(s) that is not used as a spectator/emergency exit (e.g. a ball-retrieval or grounds machinery gate) this needs to be clearly signed to avoid confusion in an emergency or evacuation.

ADVISORY	Part of a ground capacity calculation is calculated using entrances and exits, clubs should refer to the criteria set out in the Sports Ground Safety Authority – Guide to Safety at Sports Grounds.
NEW BUILDS AND CONVERSIONS	Consideration should be given to the location of exits depending upon the size of the facilities and capacity.



6 NATIONAL STADIUM ACCREDITATION CRITERIA

1. GROUND (continued)

1.15 Lighting

Clubs have a responsibility to ensure the safety of spectators entering, leaving and moving about the ground and, if a ground is used in non-daylight hours, adequate artificial lighting should be provided.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	There must be an emergency lighting system for all spectator areas and concourses as required by the local Safety Authority or approved by a competent person.
ADVISORY	<p>Consideration must be given by a club to its safety procedures in the event of a power failure and be detailed within a Club's Emergency Action Plan. Clubs must ensure that key matchday personnel are familiar with the safety procedures and the Emergency Action Plan.</p> <p>Grades 2 and below While their installation is strongly recommended, neither working nor emergency lighting is a grading requirement. However, clubs are reminded that they have a responsibility to ensure the safety of spectators entering, leaving and moving about the ground and, if a ground is used in non-daylight hours, adequate artificial lighting should be provided.</p>

1.16 TV Gantry/Camera platform

Currently, only Grade 1 has requirements for a TV Gantry and Camera platform:

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	A permanent TV gantry or camera platform that meets the following minimum criteria: Clubs are to provide a suitable position in the stadium from which to film single-camera footage of matches. This should be exactly on the halfway line, facing away from the sun and protected from the weather, at least four metres above pitch level, and have a nearby 13A power socket. Whilst not a requirement, the ideal angle is 12-14 degrees to the centre line and 22-24 degrees from the near-side. If there is no existing gantry, a scaffold should be built, insured and properly maintained to Health & Safety Executive standards

1.17 Adjoining Pitches

Where deemed that they are likely to interfere with the playing of a match, ball games must not be played on adjoining pitches whilst a match is in progress. At Grades 1 to 4, adjoining pitches must be fenced off to a height of 1.70 metres to create an enclosed ground.

1.18 Emergency Access

Access must be provided for the emergency services and be maintained so that they are free from obstruction.

Access will differ from ground to ground but principles of appropriate access would include: gates on the pitch perimeter barrier to allow ambulance access (or at least, access for a wheeled stretcher/spinal board to be navigated without challenge, hard standing from the point of the barrier gates to the designated ambulance access route, ideally the route to be marked with yellow cross-hatching (at worst, that stewards know where to screen off to allow emergency access to and from the pitch, a designated ambulance parking space that has easy access to the pitch and/or clubhouse/medical room).

Such access must be detailed within a Club's Emergency Action Plan and be communicated to key matchday personnel.



NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES

2.1 Spectator Accommodation

Covered accommodation, which should preferably be on at least two sides of the ground, must be of sound construction of timber/steel/brick/concrete or any combination of these materials. Requirements regarding spectator numbers for such covered accommodation are set-out in the table below. Existing timber stands are only acceptable subject to a fire risk assessment conducted by a competent person.

While individual seating is preferred, existing bench seating may be permitted provided it is in good repair and that individual spaces (each space a minimum of 500mm in width) are clearly marked. **Note: at Grades 1 & 2 bench seating will not** be included in any calculation for the required minimum covered seating accommodation.

All seating must afford a good view of the pitch and be clean, functional and in good condition. Where seats do not afford a good view of the pitch these will be deducted from the total attributable to a stands' capacity.

When calculating the capacity of a covered standing stand, this shall be in accordance with the Green Guide. Note: that flat levels can only be populated at four-people-deep as a maximum, provided the room available permits and a minimum 0.9m wide clear walkway is maintained.

Segregation

When segregation is in operation, there must be adequate toilet facilities and refreshment facilities in each segregated area in addition to the appropriate means of entry and exit.

Standing spectators are not allowed in or near a seated spectator stand where they can obstruct views. Areas where spectators are not permitted to stand must be clearly marked with yellow hatched markings. Alternatively, appropriate signage may be acceptable.

Hard standing

As listed below, acceptable hard standing materials include tarmac, concrete and concrete paving. Any other materials which create a bound material must be approved by The FA. For the avoidance of doubt, artificial turf does not constitute as hard standing (save for where dispensation was provided prior to the 2016/17 season). Where 'well maintained grassed areas' are permitted, artificial turf may be used in those areas provided that it is professionally installed (this will not be counted as hard standing for capacity figures, however). Short pile artificial turf may be used as a walkway in stadia where large stands exist but spectators are not permitted to view games from it. Such arrangement must be professionally installed, on a flat surface and maintained so that it does not present a trip or slip hazard.

6 NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES (continued)

2.1 Spectator Accommodation (continued)

Below are the requirements Grade-by-Grade requirements. The minimum covered accommodation calculation is inclusive of Directors/Committee and/or Press seating:

	Min. covered accommodation	Other	Directors' seats	Segregation	Hard standing
GRADE 1	For 500 (all seated) with no stand attributable to the capacity calculation if less than 100 seats.	A minimum of four rows is required to the dimensions recommended in 'The Guide to the Safety at Sports Grounds' (Green Guide). In order to meet the sight line requirements, it is recommended that the first line of seating is located above pitch level. There must be an unobstructed view from the lowest level of the seated area. Seats should ideally be of the tip-up type with back rests. Alternatively, other than in the Directors' Box, the seats may be of the plastic moulded type complete with back rests or other types of seats, provided that they have back rests. Temporary structures will not be accepted.	Home – min. of 24 seats Away – min. of 16 seats These seats must be clearly marked "Home" and "Away Directors" and should enjoy a prime position in the main stand.	Clubs must be able to demonstrate that visiting supporters can be segregated when necessary.	Hard standing to a minimum width of 0.9 metre, measured from the spectator side of the pitch perimeter barrier, must be provided on all four sides of the ground, unless a different configuration exists (as set out in section 1). The surface must be tarmac, concrete, concrete paving or other approved materials which create a bound material. Any level surfaces within the immediate ground must be hard standing. i.e. tarmac, concrete, concrete paving or other approved materials.
GRADE 2	For 500 of which 250 are seats. With no stand attributable to the capacity calculation if less than 100 seats.		Home – min. of 12 seats Away – min. of 12 seats These seats must be clearly marked "Home" and "Away Directors" and should enjoy a prime position in the main stand.		Hard standing to a minimum width of 0.9 metre, measured from the spectator side of the pitch perimeter barrier, must be provided on all four sides of the ground, unless a different configuration exists (as set out in section 1). The surface must be tarmac, concrete, concrete paving or other approved materials which create a bound material.
GRADE 3	For 500, of which 250 are seats. With no stand attributable to the capacity calculation if less than 50 seats.	Additional seating may be provided in other areas of the ground. However, these seats are not to be classed as being 'in lieu' of the number shown to the left.	Home – min. of 10 seats Away – min. of 10 seats These seats must be clearly marked 'Home' and 'Away Directors' and should enjoy a prime position in the main stand.	Clubs must be able to demonstrate that visiting supporters can be segregated when necessary.	Hard standing to a minimum width of 0.9 metre, measured from the spectator side of the pitch perimeter barrier, must be provided on all four sides of the ground, unless a different configuration exists (as set out in section 1). The surface must be tarmac, concrete, concrete paving or other approved materials which create a bound material.
GRADE 4	For 300, of which 150 are seats. With no stand attributable to the capacity calculation if less than 50 seats.			No segregation requirement	

6

NATIONAL STADIUM ACCREDITATION CRITERIA 2. SPECTATOR FACILITIES (continued)

2.1 Spectator Accommodation (continued)

	Min. covered accommodation	Other	Directors' seats	Segregation	Hard standing
GRADE 5	For 200, of which 100 are seats. With no stand attributable to the capacity calculation if less than 50 seats.	Additional seating may be provided in other areas of the ground. However, these seats are not to be classed as being "in lieu" of the number shown to the left. Where a club shares its ground with a cricket club which limits the amount of permanent hard standing which can be installed, a maximum of one side or end of temporary flooring made of a polypropylene material or such like may be acceptable. Precise details of the specification must be supplied to the league and The FA before its installation. Spectators must not be permitted to access any end/side without hard standing. NB: Where the facility is shared with cricket, hard standing on a minimum of two-and-a-half sides may be acceptable.	Home – min. of 8 seats Away – min. of 8 seats These seats must be clearly marked "Home" and "Away Directors" and should enjoy a prime position in the main stand.	No segregation requirement	Hard standing to a minimum width of 0.9 metre, measured from the spectator side of the pitch perimeter barrier, must be provided on three sides of the ground. Existing athletics stadia may be exempt from this requirement and each case will be considered by the Stadium Accreditation Sub-Committee on its own merits. The surface must be tarmac, concrete, concrete paving or other approved materials which create a bound material.
GRADE 6	For 100, of which 50 are seats in no more than one stand.	Where a club shares its ground with a cricket club which limits the amount of permanent hard standing which can be installed, a maximum of one side or end of temporary flooring made of a polypropylene material or such like may be acceptable. Precise details of the specification must be supplied to the league and The FA before its installation.	Separate seating for Directors/Committee and guests is not compulsory for this grade.		Hard standing to a minimum width of 0.9 metre, measured from the spectator side of the pitch perimeter barrier, must be provided on a minimum of two adjacent end/sides of the ground with direct access from the entrance. The surface must be tarmac, concrete, concrete paving or other approved materials which create a bound material.
GRADE 7	The minimum covered accommodation must be 50 (seated or standing).	Spectators must not be permitted to access any end/side without hard standing. Existing athletics stadia may be exempt from this requirement and each case will be considered by the Stadium Accreditation Sub-Committee on its own merits.			

ADVISORY	Covered accommodation for wheelchair/powerchair users and their companions Clubs are reminded of the need to accommodate disabled users of facilities. Consideration therefore needs to be given as to how the Club will meet or exceed its obligations concerning suitable covered accommodation.				
NEW BUILDS AND CONVERSIONS	Careful consideration should be given to the location of new seating and standing accommodation to ensure that it is accessible to all spectators and affords a good view of the game. Clubs should carefully research the different types of options available. Any hard standing should be constructed to a minimum width of 1.2m in-line with the Sports Ground Safety Authority – Guide to Safety at Sports Grounds.				

6

NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES (continued)

EXAMPLES OF SPECTATOR ACCOMMODATION



6 NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES (continued)

2.2 Press Seating

All press seating must be provided with lighting and writing facilities for use by the press and other media. The press seating must have a clear view of the field of play. All press seating will ideally have an appropriate power socket for the charging of phones, laptops etc. per press seat.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	A minimum of 12 seats for the press must be provided.
GRADE 2	A minimum of 6 seats for the press must be provided.
GRADE 3	A minimum of 4 seats for the press must be provided.
GRADE 4	A minimum of 2 seats for the press must be provided.
GRADE 5	There is no requirement for dedicated press seating.
GRADE 6	
GRADE 7	

EXAMPLES OF PRESS SEATING



6

NATIONAL STADIUM ACCREDITATION CRITERIA 2. SPECTATOR FACILITIES (continued)

2.3 Terracing

All terracing must be in sound condition and must comply with the requirements of the [Sports Ground Safety Authority – Guide to Safety at Sports Grounds](#). Terracing that is crumbling, has grass/weeds growing through it or has broken or loose material will not be accepted.

Segregation

When segregation is in operation, there must be adequate toilet facilities and refreshment facilities in each segregated area in addition to the appropriate means of entry and exit.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	Any level surfaces within the ground must be hard standing, i.e. tarmac, concrete, concrete paving or other approved materials. Spectator standing areas behind the goals must be terraced unless the overall ground capacity is achieved with the exclusion of one or both of these areas. The number of terrace steps to be commensurate in achieving the overall ground capacity. Grass banking may not be acceptable within the ground. Grass banking within the ground must not be accessible for spectators to view the match. The installation of permanent barriers of a suitable height but not less than 1.1 metres will be required. The use of demountable or semi-permanent type fencing is not acceptable. All visible grassed areas must be well maintained.
GRADE 2	Any level surface within the ground should ideally be hard standing, such as tarmac, concrete, concrete paving or other approved materials which create a bound surface. However, flat and well-maintained grassed areas may be accepted, provided the width between the hard standing (when measured from the edge farther away from the perimeter barrier) and the boundary fence does not exceed 20 metres. Grass banking may not be acceptable within the ground. Grass banking within the ground must not be accessible for spectators to view the match. The installation of permanent barriers of a suitable height but not less than 1.1 metres will be required. The use of demountable or semi-permanent type fencing is not acceptable. All visible grassed areas must be well maintained. Note: For Grade 1 stepped terracing is required behind both goals unless the overall ground capacity is achieved with the exclusion of one or both of these areas.
GRADE 3	Any level surface within the ground should ideally be hard standing, such as tarmac, concrete, concrete paving or other approved materials which create a bound surface.
GRADE 4	However, flat and well-maintained grassed areas may be accepted, provided the width between the hard standing (when measured from the edge farther away from the perimeter barrier) and the boundary fence does not exceed 20 metres. Spectators must be denied access to any grass banking so that it cannot be used for viewing the match.
GRADE 5	Any level surface within the ground should ideally be hard standing, such as tarmac, concrete, concrete paving or other approved materials which create a bound surface. However, flat and well-maintained grassed areas may be accepted. The use of tree bark instead of grass may be acceptable, subject to prior permission being obtained from the league and The FA.
GRADE 6	
GRADE 7	
NEW BUILDS AND CONVERSIONS	Careful consideration should be given to the location of covered terracing accommodation to ensure that it is accessible to all spectators and affords a good view of the game. Clubs should carefully research the different types of options available.

6 NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES (continued)

EXAMPLES OF TERRACING



6

NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES (continued)

2.4 Toilets

There must be adequate toilet facilities for men and women in each area of the ground commensurate with the capacity of that area in accordance with the [Sports Ground Safety Authority – Guide to Safety at Sports Grounds](#). The minimum requirements are detailed in the table below.

Please note: where urinals are referenced below, these can be replaced with WCs but not vice-versa (e.g. four urinals and two WCs could be replaced by six WCs).

Accessible toilets

Clubs are reminded that it is a legal requirement to make reasonable adjustments to accommodate disabled users of facilities. If facilities for disabled users exist in the club’s clubhouse, they should ideally be clearly signposted.

Family facilities

Clubs are encouraged to consider the needs of all spectators and the facilities that they might require such as baby-changing facilities, facilities for young children and women’s toiletry provision. In female and accessible toilets (or those that are gender neutral), Clubs must provide an appropriate means of disposal for sanitary products in female washrooms. This can include providing sanitary bins and sanitary bags. It is also strongly advised that there is one such bin provided in a male WC for the disposal of any men’s medical waste.

Segregation

When segregation is in operation, there must be adequate toilet facilities and refreshment facilities in each segregated area in addition to the appropriate means of entry and exit. Individual toilet units, often known as ‘portaloo’s’, are permissible on a temporary basis but may not be included in the minimum toilet requirements.

Note: For the avoidance of doubt, spectator toilets are not permitted in the same corridor as the player or match official dressing rooms. Where gender neutral toilets are provided, the total number of units provided must match the minimum number required for both male and female combined.

GRADE-SPECIFIC REQUIREMENTS	
GRADE 1	<p>A minimum of two units of toilet facilities must be provided located in two separate areas within the ground, excluding those located in the clubhouse, or accessible only from within the main stand. Each unit must contain the minimum of:</p> <p>Male: Four urinals or equivalent and two WCs</p> <p>Female: Two WCs</p> <p>In addition, wash hand basins with running water, warm air hand driers and/or paper towel dispenser with towels and wastepaper bins must be provided in each toilet area. While replaceable linen roller towels in a cabinet are acceptable, individual hand towels are not permitted.</p> <p>All toilet areas must be in working order, with a roof and operational lighting, supplied with toilet paper and maintained to the highest level of cleanliness.</p> <p>These facilities may be of a temporary or mobile kind but must be connected to the mains supply (i.e. water and power) and main drainage or an acceptable alternative drainage system. Individual toilet units, often known as ‘portaloo’s’, are permissible on a temporary basis but may not be included in the minimum toilet requirements.</p> <p>They must be fully accessible with permanent access.</p> <p>The location of all toilet facilities must be indicated with appropriate signage.</p>

6

NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES (continued)

2.4 Toilets (continued)

GRADE-SPECIFIC REQUIREMENTS	
GRADE 2	<p>Toilets must be located within the ground and must be accessible both to male and to female spectators. Such toilets need not be in a dedicated toilet block, but must be in addition to those used by people using the clubhouse.</p> <p>The following minimum toilet facilities must be provided in total, excluding those located in any clubhouse:</p> <p>Male: Four urinals or equivalent and two WCs</p> <p>Female: Two WCs</p>
GRADE 3	<p>In addition, wash hand basins with running water, warm-air hand driers and/or paper towel dispenser with towels and wastepaper bins must be provided in each toilet area. While replaceable linen roller towels in a cabinet are acceptable, individual hand towels are not permitted.</p> <p>All toilet areas must be in working order, with a roof and operational lighting, supplied with toilet paper and maintained to a high level of cleanliness.</p> <p>These facilities may be of a temporary or mobile kind but must be connected to the mains supply (i.e. water and power) and main drainage or an acceptable alternative drainage system. They must be fully accessible with permanent access.</p> <p>Individual toilet units often known as ‘portaloo’s’ are permissible on a temporary basis but may not be included in the minimum toilet requirements.</p> <p>The location of all toilet facilities must be indicated with appropriate signage.</p>
GRADE 4	<p>Toilets must be located within the ground and must be accessible both to male and to female spectators. Such toilets need not be in a dedicated toilet block but must be in addition to those used by people using the clubhouse.</p> <p>The following minimum toilet facilities must be provided in total, excluding those located in any clubhouse:</p> <p>Male: Two urinals or equivalent and one WC</p> <p>Female: Two WCs</p> <p>In addition, wash hand basins with running water, warm air hand driers and/or paper towel dispenser with towels and wastepaper bins must be provided in each toilet area. Whilst replaceable linen roller towels in a cabinet are acceptable, individual hand towels are not permitted.</p> <p>All toilet areas must be in working order, with a roof and operational lighting, supplied with toilet paper and maintained to a high level of cleanliness.</p> <p>These facilities may be of a temporary or mobile kind but must be connected to the mains supply (ie water and power) and main drainage or an acceptable alternative drainage system. They must be fully accessible with permanent access.</p> <p>Individual toilet units often known as ‘portaloo’s’ are permissible on a temporary basis but may not be included in the minimum toilet requirements.</p> <p>The location of all toilet facilities must be indicated with appropriate signage.</p>

6

NATIONAL STADIUM ACCREDITATION CRITERIA 2. SPECTATOR FACILITIES (continued)

2.4 Toilets (continued)

	GRADE-SPECIFIC REQUIREMENTS
GRADE 5	<p>Toilets should be located within the ground and must be accessible to both male and to female spectators. NB: Where it is necessary to exit the ground to gain access to toilets located in an adjacent clubhouse, these may be deemed acceptable, provided no great distance is involved and that the total units listed below are met with the club house provision.</p> <p>The following minimum toilet facilities must be provided:</p> <p>Male: Two urinals or equivalent and one WC</p> <p>Female: Two WCs</p> <p>In addition, wash hand basins with running water, warm air hand driers and/or paper towels, together with a supply of toilet paper, must be provided in each toilet area. Whilst replaceable linen roller towels in a cabinet are acceptable, individual hand towels are not permitted.</p>
GRADE 6	<p>The provision of toilet facilities within a clubhouse will be acceptable if these are accessible and available at all times on match days.</p> <p>All toilet areas must be in working order, with a roof and operational lighting, supplied with toilet paper and maintained to a high level of cleanliness.</p> <p>These facilities may be of a temporary or mobile kind but must be connected to the mains supply (ie water and power) and main drainage or an acceptable alternative drainage system.</p> <p>They must be fully accessible with permanent access.</p> <p>Individual toilet units, often known as 'portaloos', are permissible on a temporary basis but may not be included in the minimum toilet requirements. The location of all toilet facilities must be indicated with appropriate signage</p>
GRADE 7	<p>Toilets should be located within the ground and must be accessible both to male and to female spectators.</p> <p>Where it is necessary to exit the ground to gain access to toilets located in an adjacent clubhouse, these may be deemed acceptable, provided no great distance is involved.</p> <p>A minimum of two WCs must be provided.</p> <p>In addition, wash hand basins with running water, warm-air hand driers and/or paper towels, together with a supply of toilet paper, must be provided in each toilet area.</p> <p>All toilet areas must be in working order, with a roof and operational lighting, and maintained to a high level of cleanliness.</p> <p>These facilities may be of a temporary or mobile kind but must be connected to the mains supply (i.e. water and power) and main drainage or an acceptable alternative drainage system.</p> <p>They must be fully accessible with permanent access.</p> <p>Individual toilet units, often known as 'portaloos', are permissible on a temporary basis but may not be included in the minimum toilet requirements.</p> <p>The location of all toilet facilities must be indicated with appropriate signage.</p>
NEW BUILDS AND CONVERSIONS	<p>Careful consideration should be given to the location of toilet provision in the ground and in the clubhouse for all users and spectators.</p> <p>Consideration should be given to the location of services if there is a need to bring in additional toilet facilities.</p> <p>Club should consult their Local Authority Building Control Team for advice to ensure that any improvements meet applicable building regulations.</p>

6 NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES (continued)

EXAMPLES OF TOILETS



6 NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES (continued)

2.5 Refreshment Facilities

2.5.1 Directors/Committee/Guests

The following provisions must be made in relation to Refreshment Facilities for Directors/Committee Members/Guests:

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	A separate Directors' room, ideally near to or adjacent to the Directors' seating, must be made available in which refreshments for Directors and guests can be served. The room must be able to accommodate a minimum of 24 persons, with nearby toilet facilities.
GRADE 2	
GRADE 3	A separate room or adequately screened-off area must be made available in which refreshments for Directors/Committee and guests can be served. These areas must be able to accommodate a minimum of 20 persons, with nearby toilet facilities.
GRADE 4	
GRADE 5	Retractable partitions or free-standing screens may be acceptable, provided they are of a height and position to afford complete privacy.
GRADE 6	A separate room or reserved area must be made available in which refreshments for Directors/Committee and guests can be served.
GRADE 7	Refreshments must be made available for visiting officials and guests.

2.5.2 Ground Refreshment Facilities

Refreshment facilities, which may be permanent or of the mobile type, must be available to spectators in:

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	The ground.
GRADE 2	
GRADE 3	
GRADE 4	
GRADE 5	In addition, where segregation is deployed, refreshment facilities will be required in each segregated area of the ground. Where multiple large stands in a stadium exist, then refreshment facilities should be available so that all spectators have access to at least one facility.
GRADE 6	
GRADE 7	
NEW BUILDS AND CONVERSIONS	The ground or in an adjacent clubhouse.
	Careful consideration should be given to size and location of refreshment facilities both inside the ground and in the clubhouse for ease of access and revenue generation.

6 NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES (continued)

2.5 Refreshment Facilities

EXAMPLES OF REFRESHMENT FACILITIES



6 NATIONAL STADIUM ACCREDITATION CRITERIA

2. SPECTATOR FACILITIES (continued)

2.6 Equal Provision for All

A club must take account of the needs of all spectators and be mindful of its obligations under the provisions of the Equality Act 2010 any other relevant legislation.

Clubs are required to ensure that there is adequate provision in place for spectators who have specific requirements covered by the Equality Act. It is recommended that provision is made to accommodate spectators in all areas of the ground, but specific attention should be paid to the following:

- Entrances and Exits
- Access around the ground
- Covered viewing area
- Spectator toilet provision

ADVISORY

Clubs improving their facilities should make reference to the relevant publications/data sheets issued by The FA, the Football Foundation and Sport England.

Clubs should also consult their Local Authority Building Control Team for advice to ensure that any improvements meet Part M of the [2010 Building Regulations](#).



6

NATIONAL STADIUM ACCREDITATION CRITERIA

3. DRESSING ROOM FACILITIES

3.1 Players

Separate dressing rooms must be provided for both teams within the enclosed area of the ground. The dressing rooms must be of sound construction and be of a permanent nature.

Dressing room size calculations must exclude any corridors leading to the open changing area, as well as the shower and toilets areas.

All shower heads and hand wash basins listed below must have hot and cold running water. Hand wash basins and hand drying facilities must be located outside the shower area.

WCs must be in cubicles that are contained within the dressing room and not in an adjacent room in a corridor. WCs can replace urinals, but not vice-versa.

Clubs must provide an appropriate means of disposal for sanitary products in dressing rooms. This can include providing sanitary bins and sanitary bags. This is irrelevant of whether or not the ground currently hosts a regular female team.

There must be a treatment table which is clean and in good condition in each dressing room or within a player’s medical room within the vicinity of the dressing rooms (note: there must be two separate treatment tables – one for each competing team and this must not be a shared provision).

The following is required for each Grade:

	Dressing Room Size	No. of Shower Heads	No. of Hand Wash Basins	No. of Urinals	No. of WCs	
GRADE 1	18 square metres	4	1	2	1	
GRADE 2						
GRADE 3						
GRADE 4						
GRADE 5	12 square metres *			None		
GRADE 6						
GRADE 7						

* These will ideally be 18 square metres.

NEW BUILDS AND CONVERSIONS	Where clubs are planning to build new changing rooms, these must be of a minimum size of 18 square metres, excluding shower and toilet areas.
----------------------------------	---

6 NATIONAL STADIUM ACCREDITATION CRITERIA

3. DRESSING ROOM FACILITIES (continued)

EXAMPLES OF PLAYERS' DRESSING ROOMS



6

NATIONAL STADIUM ACCREDITATION CRITERIA

3. DRESSING ROOM FACILITIES (continued)

3.2 Match Officials

All dressing room areas must be maintained to a high standard of cleanliness and be heated, well-ventilated and secure on matchdays.

Clubs must provide an appropriate means of disposal for sanitary products in dressing rooms. This can include providing sanitary bins and sanitary bags.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	<p>The size of the match officials' dressing room must be a minimum of six square metres excluding the toilet and shower areas.</p> <p>The match officials' dressing room must have:</p> <ul style="list-style-type: none"> • At least one shower, one wash basin (both with hot and cold running water) • At least one WC in a cubicle <p>Note: On promotion to EFL an additional shower will be required.</p> <p>Provision should be made for separate dressing rooms for male and female match officials. Where new dressing rooms are being constructed or existing ones are being re-designed, separate purpose-built facilities for male and female match officials must be provided.</p> <p>There must be an audible electronic warning device (bell or buzzer) in working order located in the match officials' dressing room linked to both players' dressing rooms.</p>
GRADE 2	<p>The size of the match officials' dressing room must be a minimum of six square metres, excluding shower and toilet areas.</p> <p>Each match officials' dressing room must have the following:</p>
GRADE 3	<ul style="list-style-type: none"> • At least one shower and one wash basin (both with hot and cold running water) • At least one WC in a cubicle
GRADE 4	<p>Provision should be made for separate dressing rooms for male and female match officials. Where new dressing rooms are being constructed or existing ones are being re-designed, separate purpose-built facilities for male and female match officials must be provided</p> <p>There must be an audible electronic warning device (bell or buzzer) in working order located in the match officials' dressing room and linked to the players' dressing rooms.</p>



NATIONAL STADIUM ACCREDITATION CRITERIA

3. DRESSING ROOM FACILITIES (continued)

3.2 Match Officials (continued)

GRADE-SPECIFIC REQUIREMENTS	
GRADE 5	The size of the match official’s dressing room must be a minimum of four square metres (ideally six square metres), excluding shower and toilet areas. Each match officials’ dressing room must have the following:
GRADE 6	<ul style="list-style-type: none">• At least one shower and one wash basin (both with hot and cold running water)• At least one WC in a cubicle
GRADE 7	Provision should be made for separate dressing rooms for both male and female match officials. Where new dressing rooms are being constructed or existing are being re-designed, separate purpose-built facilities for both male and female match officials must be provided. There must be an audible electronic warning device (bell or buzzer) in working order located in the match officials’ dressing room, and which is linked to the players’ dressing rooms.
NEW BUILDS AND CONVERSIONS	When new dressing rooms are being constructed the match officials’ room should be a minimum of six square metres in size, excluding shower and toilet areas. Where new dressing rooms are being constructed or existing are being re-designed, separate purpose-built facilities for both male and female match officials must be provided.

6 NATIONAL STADIUM ACCREDITATION CRITERIA

3. DRESSING ROOM FACILITIES (continued)

EXAMPLES OF MATCH OFFICIALS' DRESSING ROOMS





NATIONAL STADIUM ACCREDITATION CRITERIA

4. MEDICAL

A working defibrillator must be located within the ground in accordance with the Standardised Rules.

Clubs should make themselves aware of the checklist issued by the Sports Ground Safety Authority – Medical Room Checklist.

	GRADE-SPECIFIC REQUIREMENTS
GRADE 1	<p>There must be a suitably-equipped medical treatment room for players located in the vicinity of the players' dressing rooms. Access to this room must not be via the home or away dressing rooms.</p> <p>At least one stretcher for the removal of injured players from the field of play must be provided.</p> <p>There must be a suitably equipped and designated First Aid/Medical Room for spectators within the boundary of the ground.</p> <p>The designated room must contain a bed or comfortable seating, with cold and, ideally, hot water, together with paper towels. Reusable individual towels are not permitted.</p> <p>The first-aid room and the location of the room must be suitably signposted.</p>
GRADE 2	<p>There must be a suitably-equipped medical treatment room for players located in the vicinity of the players' dressing rooms. Access to this room must not be via the home or away dressing rooms.</p> <p>At least one stretcher for the removal of injured players from the field of play must be provided.</p> <p>Clubs must designate on matchdays a suitable room for the treatment of spectators within the boundary of the ground. The designated room must contain a bed or comfortable seating, with cold and, ideally, hot water, together with paper towels. Reusable individual towels are not permitted.</p> <p>The location of the room must be suitably signposted.</p>
GRADE 3	<p>There must be a suitably-equipped medical treatment room located in the vicinity of the players' dressing rooms for the use of both players and spectators. Access to this room must not be via the home or away dressing rooms.</p>
GRADE 4	<p>The designated room must contain a bed and/or comfortable seating, with cold and, ideally, hot water, together with paper towels. Reusable individual towels are not permitted.</p> <p>At least one stretcher for the removal of injured players from the field of play must be provided.</p>
GRADE 5	<p>All clubs must provide first-aid equipment, including a stretcher, for the use of players and spectators. Its location in the ground, if other than in a dedicated treatment room, should be clearly marked by notices placed in the dressing rooms for teams and match officials.</p>
GRADE 6	
GRADE 7	<p>Clubs should ideally have a working defibrillator located within the ground.</p> <p>A stretcher must be provided for the removal of injured players from the pitch.</p>
ADVISORY	<p>There must be a nominated and suitably-qualified person in attendance to assist with spectator problems unless the St. John Ambulance Brigade, Red Cross Society or other capable agency are in attendance. The requirements of the Guide to Safety at Sports Grounds are for one first-aider per 1,000 anticipated spectators, with a minimum of two.</p> <p>If a crowd of less than 2,000 is anticipated, known and practised arrangements should be in place to summon either a doctor or NHS ambulance alternative. For crowds of over 2,000, an experienced crowd doctor should be in attendance.</p> <p>NB: The above in no way purports to be a comprehensive list of Health and Safety issues which it is the responsibility of a club to address. Clubs are recommended to arrange regular safety audits conducted by persons with the appropriate expertise.</p>

6

NATIONAL STADIUM ACCREDITATION CRITERIA 5. APPLICATION FOR MEMBERSHIP OF THE EFL

FORMAL APPLICATION TO THE EFL

It is the responsibility of each Club seeking promotion from Step 1 to the EFL to source the relevant information, issued from time to time by the EFL, in order to enter an 'Application for Membership'.





The Football Association
Wembley Stadium
London HA9 0WS
T: +44 (0)800 169 1863
F: +44 (0)800 169 1864
W: TheFA.com